


Protection and separation requirements for power and telecommunications cables
© BRANZ 2010

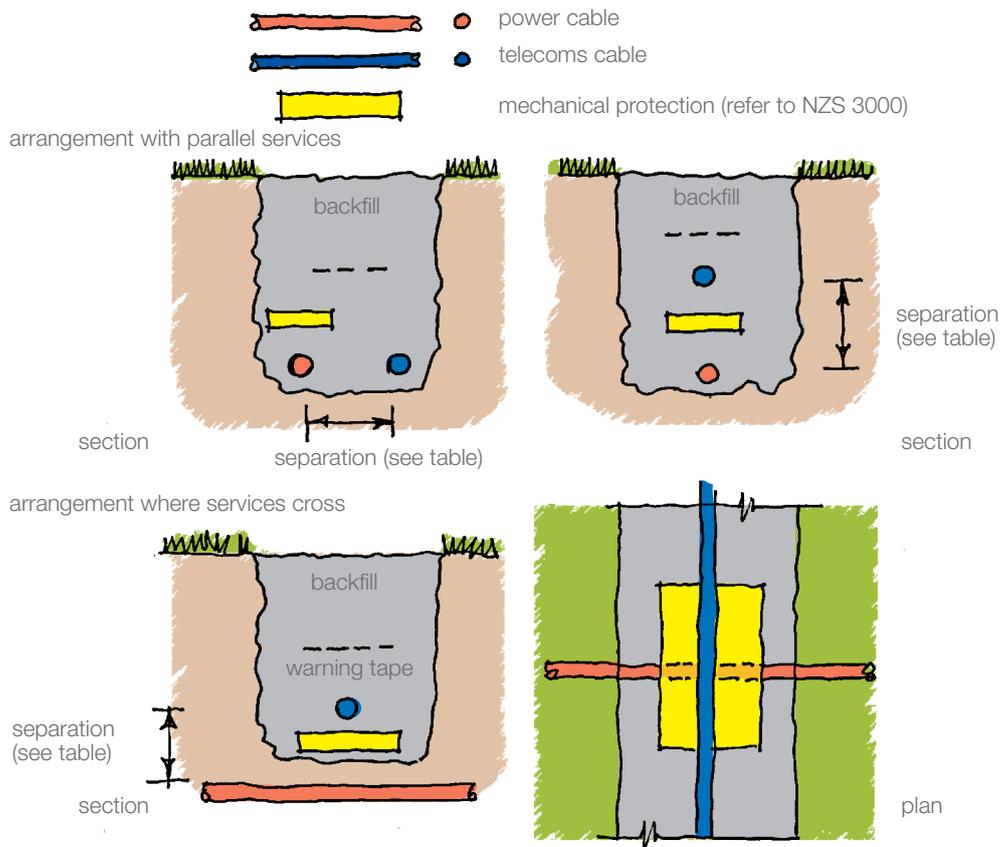

Separation requirement between power and telecoms cables			
Power cable voltage	Power cable type	With mechanical protection	Minimum separation mm
Up to and including 650 volts	Neutral screened	No	150
		Yes	50
	Other than neutral screened	No	450
		Yes	50 crossing 450 parallel
Exceeding 650 volts	Single or multi-core	No	450
		Yes	150 crossing 450 parallel